

# Fault detection and location based SVM for three phase transmission lines utilizing positive sequence fault components.

Ganesh Shingade<sup>1</sup>, Sweta Shah<sup>2</sup>

<sup>1,2</sup>*Indus University, Ahmedabad - India*

ORCID: <sup>1</sup>[0000-0002-3390-0369](https://orcid.org/0000-0002-3390-0369), <sup>2</sup>[0000-0002-5000-6174](https://orcid.org/0000-0002-5000-6174)

Received: June 29, 2023.

Accepted: August 08, 2023.

Published: September 01, 2023.

**Abstract**— Transmission lines are an imperative element of the modern power systems. Any faults in them can cause an undesirable interruption in power supply. Precise analysis of these faults is important in-order to ensure an incessant supply of power. For this purpose, fault detection and classification are needed to clear any such faults and re-establish the system to maintain its normal operation. In this paper, a novel integrated approach of protective relaying with enhanced support vector machine algorithm has been adopted for detecting faults and its location estimation in long transmission line. The proposed scheme is successfully able to detect and classify different symmetrical and unsymmetrical faults along with some peculiar cases related to High Impedance Faults (HIF) and evolving faults, current transformer (CT) saturation/ capacitive voltage transformer (CVT) transient, close-in faults, swing condition, source strength variation, etc. The comparative analysis with recent proposed techniques declared the potentiality and robustness of the scheme.

**Keywords:** fault identification, fault classification, support vector machine (svm), positive sequence analyzer, transmission lines, electrical fault detection.

\*Corresponding author.

Email: [ganeshshingade.19.rs@indusuni.ac.in](mailto:ganeshshingade.19.rs@indusuni.ac.in) (Ganesh Shingade).

Peer reviewing is a responsibility of the Universidad de Santander.

This article is under CC BY license (<https://creativecommons.org/licenses/by/4.0/>).

How to cite this article: G. Shingade and S. Shah, "Fault detection and location based SVM for three phase transmission lines utilizing positive sequence fault components", *Aibi research, management and engineering journal*, vol. 11, no. 3, pp. 61-70 2023, doi: [10.15649/2346030X.3302](https://doi.org/10.15649/2346030X.3302)

## I. INTRODUCTION

Long transmission lines cover a lot of ground and are frequently subject to various issues. Short circuits between the lines and with the ground commonly result from environmental restrictions like storms, snow, and other similar events, as well as other little but natural worries like animals, birds, and even developing flora troubles. They trigger slight to major transmission line breakdowns. According to data [1], line failures are the most common electrical system defect. Numerous methods that use line data from one or more terminals to pinpoint the location of faults fall under the categories of analytical methods, methods based on artificial intelligence (AI), methods using magnetic sensors, methods using travelling waves, and methods based on software [2], [3], [4], [5].

Any transmission line protection system should have two main objectives: to increase reliability through high-speed directional relaying and fault classification. One of the most important tasks for safeguarding electricity transmission lines is classifying the fault type, such as whether it is a single-phase-to-ground, double-phase-to-ground, phase-to-phase, or three-phase type. Once the type of fault has been determined, finding the defect is essential [6-8].

Numerous methodologies have been employed over the past 20 years to classify faults in power transmission lines. For double-circuit lines, a combined unsupervised/supervised neural network-based fault classification technique [9] has been introduced. A modified digital distance relaying mechanism has been proposed in [10] specifically for inter-circuit errors. Furthermore, a clever strategy [11] based on ANNs has been developed to perform a number of protective relaying tasks, including fault detection (both forward and reverse), classification, and zone/section estimate, providing primary protection for 95% of the line length. For the diagnosis of faults in the electric power system, SVM, another paradigm of artificial intelligence technique, has been used [12-23]. The main advantage of SVM is that it requires fewer training patterns and trains faster. Furthermore, transmission line distance relaying has been implemented using SVM and radial basis function neural network [13]. SVM has been used to locate power transmission line failures in [14]. Additionally, wavelet and SVMs have been used to classify fault zones in [17] and identify fault zones in transmission lines with series compensation in [15, 16].

To describe the detection, classification of faulty phase, and location of fault in two-terminal transmission line, DWT and artificial neural network (ANN) have been utilized [24, 25]. However, the placement algorithms for [24, 25] differ for grounded and non-grounded fault, which complicates computation. In [26], a guided protection method for the location and detection of double-circuit transmission line faults utilizing DWT and ANN was put out. In order to tackle the difficult non-linear optimization problem using AI techniques, deep neural network (DNN) has been developed as an alternative to ANN [27].

This study's main contribution is a novel integrated protective relaying method with an improved support vector machine algorithm for locating long transmission line faults. The proposed approach is capable of correctly locating and classifying a wide range of symmetrical and asymmetrical faults as well as some peculiar cases involving High Impedance Faults (HIF) and evolving faults, current transformer (CT) saturation/capacitive voltage transformer (CVT) transient, close-in faults, swing condition, source strength variation, etc.

The authors have developed a fault location estimation, which is computed using positive sequence admittance of both ends of the line to identify the internal/ external faults precisely. The fault location algorithm has also been developed using positive sequence parameters. This approach is valid for all types of faults as positive sequence phasors exist for all faults unlike negative and zero sequence components.

The remainder of the document is divided into five sections. The works that already use the algorithm are described in Section 2. Section 3 explains the suggested model. Section 4 displays the power system simulation model.

The results of the detection and localization systems are displayed in Section 5. The discussion and conclusions are included in Section 6. Last but not least, we offer the reference directory.

## II. LITERATURE SURVEY

In order to restore system stability, the problematic phase or phases in a power transmission network must be removed. Numerous computational methods for fault diagnosis have been developed by researchers [28, 29]. Impedance-based techniques, traveling wave-based algorithms, and state estimation-based techniques are examples of well-known techniques that have been used to diagnosis problems. The merits and downsides of various fault detection techniques were examined by the writers. In transient-based fault location methods, the fault distance is calculated using the transient patterns of voltage and current. Additionally, a fault location methodology that uses the peak time and amplitude of the fault current at the local location with reasonable accuracy and speed was proposed in comparison to earlier impedance-based approaches.

One of the most recent developments in this area is the use of neural networks for analysis that are powered by extreme learning machines (ELMs) [30], [31]. Even when including contemporary compensating devices, Wavelet Transform (WT) has been a crucial component of numerous studies on fault analysis as a traditional method for fault signal analysis [32]. Another useful tool for fault analysis is the fuzzy inference system [33], as well as the (ANFIS) model, a hybrid model integrating wavelet analysis [34] and neural networks, which is commonly employed as a primary analytical technique alone. WT analysis has frequently been added to this hybrid model in order to create wavelet-based ANFIS models and as a useful approach of detailed analysis. As a crucial stand-alone method of research, (SVM) has also been utilized in numerous studies pertaining to power system protection algorithms. SVM-based algorithms are widely used for fault analysis as well; however, they may need a lot of training due to noise contamination [30], [31].

The energy of the sequence component of the voltage waveform was used by Moraes et al. to present a fault location strategy for distribution networks [35]. Using the Hilbert transform, the energy of the voltage waveform has been calculated. When ground is involved, zero sequence voltage signal has been taken into consideration to find the fault. On the other hand, when two or three phases are involved, the negative sequence component has been taken into consideration to find the fault. Using the Hilbert Huang transform (HHT), the online defective phase selection for a shunt-compensated transmission line has been carried out in [36]. The algorithm's performance hasn't, however, been evaluated in swing conditions. Numerous applications of fault events can make use of fuzzy logic [37-38]. [37] Has outlined a comprehensive protective

plan for a long transmission line. Discrete Fourier Transform (DFT) has been used for defect detection and categorization. The transmission line fault site has then been calculated utilizing the positive sequence component (PSC) of voltage magnitude and the fuzzy inference system (FIS). Using PSC of voltage and current signals and FIS, a directional relaying method for a double-circuit series-compensated transmission line has been developed in [38]. The main disadvantage of employing various approaches, including ANN, ANFIS, DNN, and SVM, is that they all need a significant amount of training data in order to get an acceptable level of accuracy. Additionally, testing data to achieve the desired results after training has been completed successfully may cause a delay in the entire process because it is anticipated that digital relays will need to react quickly to restore system health. This problem is not present in fuzzy-based works since FIS does not require training; nonetheless, frequency variation might be sensitive to FIS.

So, in our paper, we propose an SVM-based, communication-free fault detection scheme that offers security, speed, selectivity, and sensitivity. This has the capacity to identify many defect types. The suggested technique accomplishes 100% internal fault detection without misjudging non-operating conditions, test findings demonstrate. It has strong sensitivity to faults with high resistance and can identify faults accurately along the whole protected line.

### III. PROPOSED SYSTEM

Electricity is transported from generating stations to load centers via a network of transmission lines. Symmetrical faults (LLL and LLLG) and unsymmetrical faults (LG, LLG, and LL) may occur on the transmission line. These flaws have the potential to interrupt the supply while seriously harming the transmission and distribution system-connected equipment. Accurate detection and precise classification of fault events are essential for maintaining the stability, security, and dependability of the power system. The power system operator can decide whether or not to trigger asymmetrical circuit breaker tripping using this information.

This section provides a quick overview of the methods for fault detection and classification. Traditional line fault detection used to heavily rely on visual inspections of the faulted line parts resulting in long and tedious foot or aerial patrols. These methods were expensive and prone to more errors. Thus, the shift to automatic fault locators was not only desired, but also natural.

#### a. Fuzzy logic Technique

A fuzzy logic technique is used to locate the fault and to identify line to ground and line to line faults on a transmission line. Fuzzy technique consists of three steps, as shown in Fig. 1.

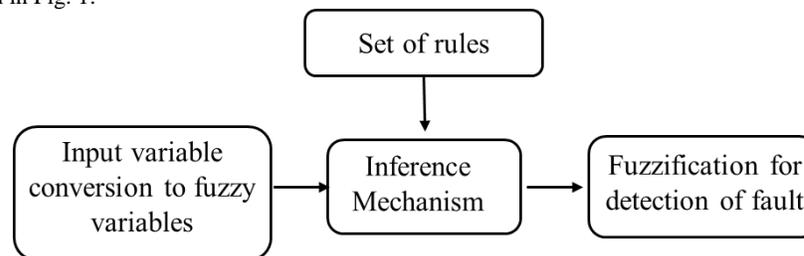


Figure 1: Structure of Fuzzy module.  
Source: Own elaboration.

In the first step, input variables are first converted in to fuzzy variables. The next step then evaluates the overall truth grade using membership function. The final fuzzification step provides crisp outputs for fault location. Membership functions of input/output variables are based on designers' knowledge and experience. It applies a set of rules appropriate to the situation, which may overlap and even contradict each other. The final course of action is appropriate combination of all relevant situations. Although the choice of number, range and shape of membership function for a variable is ultimately based on subjective design choices and evaluation of the resulting system performance, the following points have been kept in mind to match the best possible results:

- Symmetrically distribute the fuzzy sets across the defined universe of discourse.
- An odd number of fuzzy sets for each variable is used. This ensures that Some fuzzy Sets will be in the middle.
- Overlap adjacent fuzzy sets to ensure that no crisp value fails to correspond to any set.
- Triangular membership function is used as this require less computation time than others.

Figure 2 indicates the T-function description.

Triangular membership function is defined as:

$$T(u; a, b, c) = \begin{cases} 0 & \text{for } u < a \\ \frac{u - a}{b - a} & \text{for } a \leq u \leq b \\ \frac{c - u}{c - b} & \text{for } b \leq u \leq c \\ 0 & \text{for } u > c \end{cases}$$

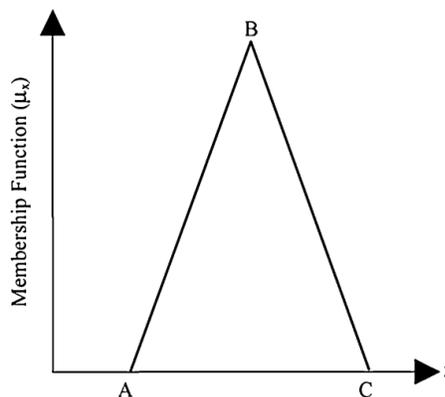


Figure 2: The T – function.  
Source: Own elaboration.

**b. Support Vector Machine (SVM) classification and prediction**

SVMs are supervised learning techniques with corresponding learning algorithms to simplify fault data analysis, identify fault patterns, and be utilized for regression and classification analysis. By employing the kernel approach and implicitly transforming their inputs into high-dimensional feature spaces, SVMs achieve classification. In this work, multiclass SVMs are utilized to estimate the direction of defect, which is possible. The identification and estimation of the fault section fall under multiple classes. But because it determines whether a specific phase is faulty or not, fault phase identification is a two-class problem (fault or no fault).

SVM is used in fault diagnosis in two stages: training with known goals and testing with unidentified samples. The SVM modules receive data as input. The network is then trained with SVM using corresponding targets for the input training data. Re-substitution error (also known as mean square error) is then used to determine how well the training SVM networks performed.

SVMs can effectively do non-linear classification in addition to linear classification by implicitly mapping their inputs into higher dimensional feature spaces. This technique is known as the kernel trick. Input vectors are non-linearly transferred to a very high dimensional feature space by the machine, which conceptually embodies this approach. A linear decision surface is built in this feature space. High generalization ability of the learning machine is ensured by unique qualities of the decision surface.

The trained SVM network created for various jobs is then tested against a variety of fault instances to produce outputs. Below fig 3 shows the SVM classification characteristics.

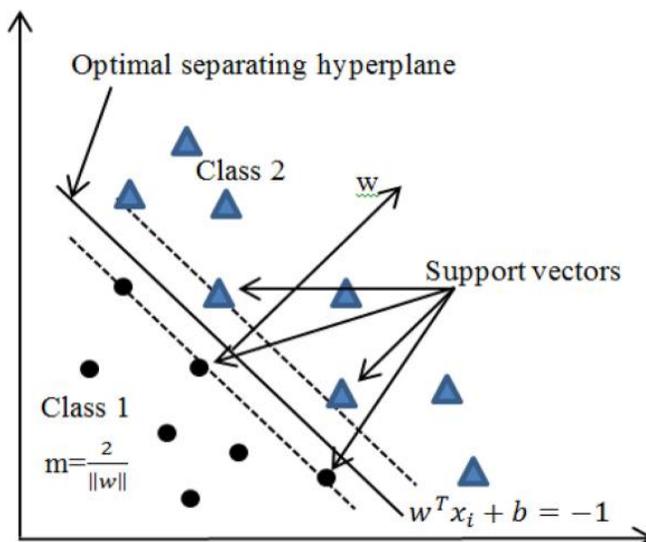


Figure 3: SVM classification.  
Source: Own elaboration.

The SVM model uses the 3-phase currents, voltages, and time and frequency parameters as input features. Let's have a look at a two-class training data set with N data points,  $\{x_i, y_i\}_{i=1}^N$ . The  $i$ th real-valued input vector is designated by the notation  $x_i$ , and its associated class,  $y_i$ , has a value of either +1 or -1. The equation yields a hyperplane that divides these points into their respective classes.

$$w^T x_i + b = 0$$

as shown in Fig. 1. 'w' and 'b' represent weight vector and bias term (vector), respectively, and determine the position of the separating hyper-plane. Finding the value of w and b that maximizes the separation between the classes is the goal of training. The separation margin (m) can be demonstrated to be provided by

$$m = \frac{2}{\|w\|}$$

With training, the maximum value of "m" should be raised for better separation, while the minimum value of "w" should be reached. Consequently, the SVM can be created by maximizing  $v(w)$  for linearly separable data.

$$v(w) = \frac{1}{2} w^T w$$

Subject to

$$y_i(w^T x_i + b) \geq 1$$

Providing construction of multi-class SVMs, where we build a two-class classifier over a feature vector  $\phi(x, y)$  derived from the pair consisting of the input features and the class of the datum. At test time, the classifier chooses the class  $y = \arg \max_y w^T \phi(x, y)$ . The margin during training is the gap between this value for the correct class and for the nearest other class, and so the quadratic program formulation will require that:

$$\forall i \forall y \neq y_i w^T \phi(x_i, y_i) \geq 1 - \xi_i$$

A multi-class formulation of different types of linear classifiers can be provided using this general method. It is also a straightforward example of a generalization of classification where the classes may be arbitrary structured objects with relationships defined between them rather than just a collection of independent, categorical labels. Below is a line diagram of the system that has been put into use. Thus, the prediction of fault is done using SVM as discussed above.

Proposed simulation model single line diagram is shown in below figure 4.

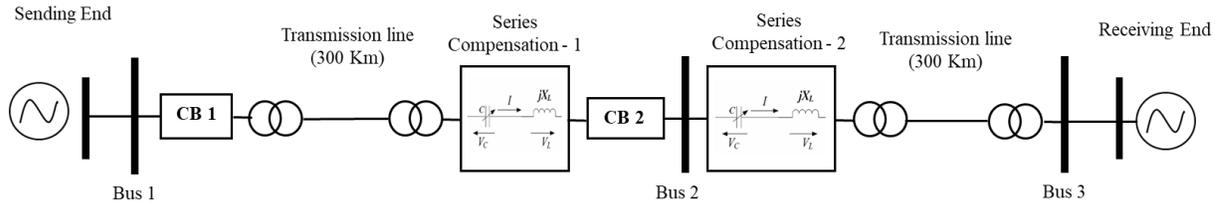


Figure 4: Line diagram of system.

Source: Own elaboration.

#### IV. METHODS

In this implementation, we have indicated that we are utilizing Positive Sequence Analyzer. The proposed work flow for calculating the features is indicated in below fig-5. We consider following six parameters for input of SVM.

1. Bus1 Voltage (V1)
2. Bus1 Current (I1)
3. Bus 2 Voltage (V2)
4. Bus 2 Current (I2)
5. Positive Sequence Voltage
6. Positive sequence Current

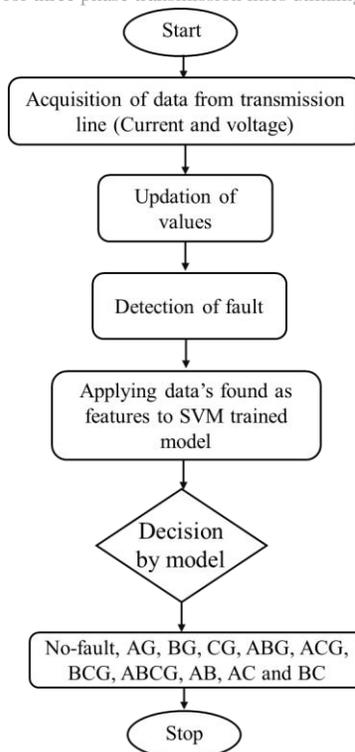


Figure 5: Proposed work flow for calculating the features.  
Source: Own elaboration.

Only positive sequence current flows for symmetrical faults (LLG or LLL), and even for LLLG, the amplitude of negative and zero sequence would be close to zero, therefore we can argue that only positive sequence represents a symmetrical fault.

No zero (very little) sequence flows in an asymmetrical fault mean that, for line to line (LL), positive equals negative if not grounded. Therefore, the fault would be line to ground (LG) or line to line and ground (LLG) if the zero-sequence component is significant. The error would be LLG if positive were equal to positive plus zero, LG if positive, negative, and zero sequences were all identical. Even when the load is out of balance, there is still a sizable negative sequence that can be utilized to identify the imbalance. As a result, the input is used at the beginning in positive sequence.

With this methodology, various faults are used each time to evaluate the classification performance. For every defect type, this process is repeated. This validation method is used in this study to inspect, confirm, and validate the SVM model's classification abilities. As a result, a generated SVM model may be installed in the substations' protective relays. The classification accuracy of the proposed SVM-based scheme is verified with the testing data set, and its performance is evaluated.

**a. Simulation model**

In this study, a 300 km double-fed, 400 kV transmission line has been taken into consideration. Fig. 6 depicts the simulated power system and relaying model. The system was created using Simulink and MATLAB. The analyzed outcomes are displayed below.

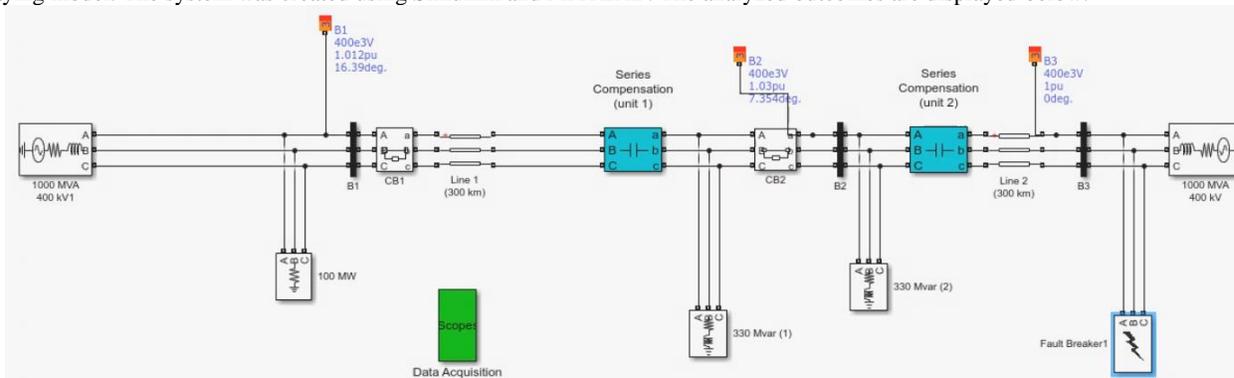


Figure 6: Simulation model for 400 KV 300 km double fed transmission line with SVM  
Source: Own elaboration.

**b. Detection of external Fault:**

The prediction of external fault is illustrated in Figure 7.

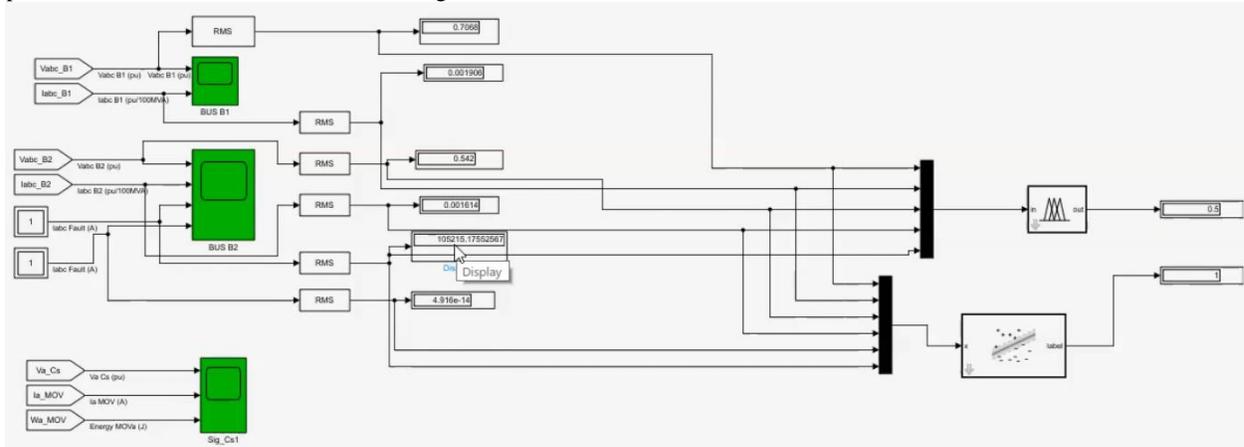


Figure 7: Simulation output of transmission line during external fault. Source: Own elaboration.

Table 1: Types of External fault Considered.

Type of Fault	Fault Resistance	X/R RATIO Variation	Source Power Variation	Load Variation	Line Length Variation
AB	1)0.001	x/r ratio change to 20	SOURCE POWER change to 1500 MVA	LOAD VARIATION to 150 MW	Line 1 Length change to 100 km  Line 2 Length change to 50KM  Changing both Line1&Line2 length at same time
AC	2)10				
BC	3) 20				
ABG	4) 30				
ACG	5)40				
BCG	6)50				
ABC	7)60				
ABCG					
AG					
BG					
CG					

Source: Own elaboration.

**c. Detection of Internal Fault:**

As is obviously shown, the proposed fault detection scheme can accurately distinguish different fault types. For the internal short-circuit fault, the proposed SVM-based detection scheme can identify the fault inception swiftly for any position along the protected line. During the internal fault, the fault breaker is located internal of long transmission line is shown in figure 8.

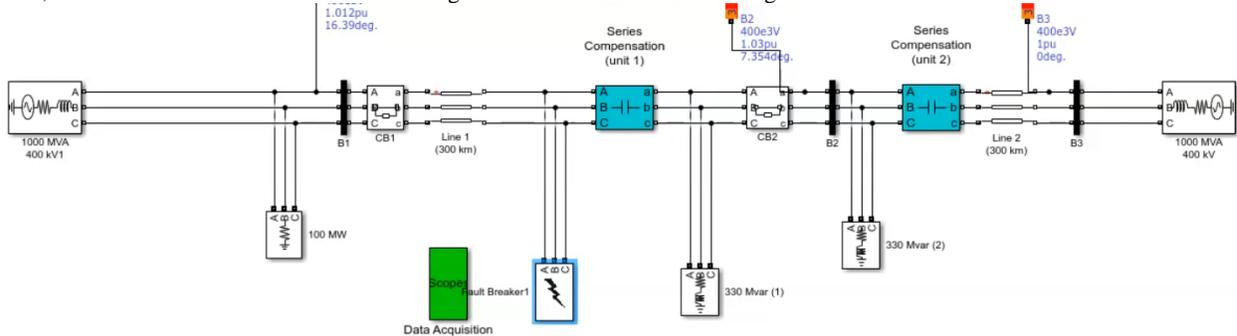


Figure 8: Simulation model for 400 KV 300 km double fed transmission line with SVM having fault internally. Source: Own elaboration.

Table 2: Types of internal faults Considered.

Type of Fault	Fault Resistance	X/R RATIO Variation	Source Power Variation	Load Variation	Line Length Variation
AB	1)0.001	x/r ratio change to 20	SOURCE POWER change to 1500 MVA	LOAD VARIATION to 150 MW	Line 1 Length change to 100 km  Line 2 Length change to 50KM  Changing both Line1&Line2 length at same time
AC	2)10				
BC	3) 20				
ABG	4) 30				
ACG	5)40				
BCG	6)50				
ABC	7)60				
ABCG					
AG					
BG					
CG					

Source: Own elaboration.

Therefore, the proposed scheme can realize fault detection of the whole transmission line, which is the core deficiency of the traveling wave-based scheme. The above-mentioned tables 1 and 2 shows that proposed scheme is successfully detecting and classifies different symmetrical and unsymmetrical faults along with some peculiar cases related to:

- High Impedance Faults (HIF) and evolving faults is detected by varying the impedance as mentioned in column 2.
- Current transformer (CT) saturation/ capacitive voltage transformer (CVT) transients are also detected by varying corresponding values as mentioned in column 4 and 5.
- Directional relays use voltage as the polarizing quantity. When three-phase faults occur close to the relay bus, the available voltage becomes nearly zero and this creates a problem in estimation of the fault direction which is called as close-in fault (or near end fault). This is detected by placing the fault breaker close to bus.
- Swinging condition and source strength variation based fault detection is also verified and detected.
- Distance variation of lines 1 and 2 are also done and verified for the fault detection as mentioned.

### V. RESULTS AND DISCUSSION

The testing data set was meticulously developed to encompass a range of fault scenarios, ensuring comprehensive evaluation of the line impedance based Detector and Classifier. The outcomes of these tests have been summarized in Table 3. In a healthy condition, where no fault is present, the expected output of both the fault detector and classifier should be zero. Conversely, in the presence of a fault, the anticipated output in the respective faulty phases should be one. Upon analyzing the data presented in Table 3, it becomes evident that following the occurrence of a fault, the output of the corresponding phases significantly increases, validating the effectiveness of the fault detection and classification system.

Table 3: Sample test results.

Fault type	Fault location (Distance from the relay in km)	Fault resistance (in ohms)	Output of the SVM classifier			
			Phase A	Phase B	Phase C	Ground G
No fault	-	-	0	0	0	0
AG	100	10	1	0	0	1
AB	80	20	1	1	0	0
AC	50	30	1	0	1	0
BC	70	40	0	1	1	0
BG	90	50	0	1	0	1
CG	150	60	0	0	1	1
ABG	200	0.001	1	1	0	1
ACG	270	20	1	0	1	1
BCG	300	60	0	1	1	1
ABC	180	50	1	1	1	0
ABCG	210	40	1	1	1	1

Source: Own elaboration.

The impedance variation is done to evaluate High impedance faults (HIF) in transmission line. Methods for detecting and classifying faults, it compares the most commonly known line parameters with the impedance measured in the event of a fault. Source strength are also varied and results are determined. According to test results, the approach's speed and selectivity are quite reliable and offer sufficient performance for a three-phase transmission line.

Accuracy: It is defined as the number of faults in the given input dataset that have been effectively categorised.

$$Accuracy = (TP + TN) / (TP + TN + FP + FN)$$

True positive (TP- the quantity of faults appropriately correctly classified as considered necessary), false positive (FP- the quantity of faults inaccurately foreseen as considered necessary), true negative (TN- the number of faults properly classified as not needed), and false negative (FN- the quantity of faults inaccurately indicated as not desirable) are the terms used in the measuring performance.

Assuming the accuracy values are stored in the variables “accuracy, ACaccuracy, BCaccuracy, CCaccuracy, DCaccuracy”. A cell array is created with the names of our models as 'Model', 'Model2', 'Model3', 'Model4', 'Model5'. Then an array is created with our accuracy values as “[accuracy, ACaccuracy, BCaccuracy, CCaccuracy, DCaccuracy]”. Then accuracy table is obtained as given in Table 4.

Table 4: Estimated accuracy table.

Model Name	Accuracy
'Model'	97.6220
'Model2'	95.3692
'Model3'	95.7447
'Model4'	98.4981
'Model5'	94.3680

Source: Own elaboration.

All models have high accuracy, ranging from 95.37% to 98.37% which on overall have average accuracy of 95.8 %. This indicates that all models are performing well on the given dataset. Model 4 has the highest accuracy of 98.37%, while Model 2 has the lowest accuracy of 95.37%.

Mean while, simulation results verify that the proposed scheme can identify short circuit faults grounded with large resistance, grounding resistance and this can be verified by varying the parameters. This improves the detection failure that may occur on current changing based fault detection schemes with a short-circuit fault through high resistance grounding. Thus, the proposed method yields 95.8 % of accuracy in approximation.

## VI. CONCLUSIONS

In this work, a single ended mixed SVM based fault classification and defective phase identification technique is proposed. The approximation coefficients of the current signals, which are only measured at one end of the line. The suggested SVM-based technique has the advantage of being able to identify the fault in both primary and backup protection up to 95% of the line length. The suggested SVM-based relay only needs a small number of training patterns. The suggested method accurately locates 95.8% of all sorts of shunt faults in a variety of locations. According to test results, the approach's speed and selectivity provide adequate performance for a three-phase transmission line and are highly dependable. Although it is a one-time offline process, the training time needed to build an SVM network increases if training data size increases due to a change in system configuration. The proposed scheme is successfully detecting and classifies different symmetrical and unsymmetrical faults along with some peculiar cases related to High Impedance Faults (HIF) and evolving faults, current transformer (CT) saturation/ capacitive voltage transformer (CVT) transient, close-in faults, swing condition, source strength variation, etc. The comparative analysis with recent proposed techniques declared the potentiality and robustness of the scheme.

## VII. DECLARATIONS

### *Availability of data and material*

In this research paper we have used MATLAB based modeling to cross verify the result of the system. Training data for SVM is generated using the MATLAB Simulation modeling in different fault scenario.

### *Competing interests*

We declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

### *Funding*

Not Applicable.

### *Authors' contributions*

Ganesh Shingade contributed to conceptualization, methodology, software, validation, analysis, investigation, data collection, draft preparation, manuscript editing.

Dr Sweta Shah contributed to validation, analysis, investigation, visualization, supervision, project administration.

### *Acknowledgements*

We are deeply grateful to all those who contributed to the success of this research project.

## VIII. REFERENCES

- [1] T. Bouthiba, "Fault location in EHV transmission lines using artificial neural networks," *Int. J. Appl. Math. Comput. Sci.*, vol. 14, no. 1, pp. 69–78, 2004, Accessed: Sep. 26, 2022. [Online]. Available: <https://eudml.org/doc/207681#.YzITSHTKOAK.mendeley>.
- [2] M. Mirzaei, M. Z. A. A. Kadir, E. Moazami, and H. Hizam, "Review of fault location methods for distribution power system," *Austral. J. Basic Appl. Sci.*, vol. 3, no. 3, pp. 2670–2676, 2009.
- [3] A. Jain, A. S. Thoke, and R. N. Patel, "Double circuit transmission line fault distance location using artificial neural network," in *Proc. World Congr. Nature Biologically Inspired Comput. (NaBIC)*, 2009, pp. 13–18, doi: [10.1109/NABIC.2009.5393593](https://doi.org/10.1109/NABIC.2009.5393593).
- [4] Q. Huang, W. Zhen, and P. W. T. Pong, "A novel approach for fault location of overhead transmission line with noncontact magnetic-field measurement," *IEEE Trans. Power Del.*, vol. 27, no. 3, pp. 1186–1195, Jul. 2012, doi: [10.1109/TPWRD.2012.2190427](https://doi.org/10.1109/TPWRD.2012.2190427).
- [5] A. S. Ghoniem, "Sub-line transient magnetic fields calculation approach for fault detection, classification and location of high voltage transmission line," *Int. J. Electr. Eng. Informat.*, vol. 11, no. 3, pp. 548–563, Sep. 2019, doi: [10.15676/ijeei.2019.11.3.7](https://doi.org/10.15676/ijeei.2019.11.3.7).
- [6] Dalstein T, Klucke B. Neural network approach to fault classification for high speed protection relaying. *IEEE Trans, P&D* 1995;10 (2):1002–11.
- [7] Dash PK, Pradhan AK, Panda G. a novel fuzzy neural network based distance relaying scheme. *IEEE T Power Deliver* 2000;15 (3):902–7.
- [8] Wang H, Keeerthipala WW. Fuzzy neuro approach to fault classification for transmission line protection. *IEEE T Power Deliver* 1998;13 (4):1093–102.
- [9] Aggarwal RK, Xuan QY, Dunn RW, Johns AT, Bennett A. A novel fault classification technique for double-circuit lines based on a combined unsupervised/supervised neural network. *IEEE Trans Power Delivery* 1999;14(4):1250–6.
- [10] Makwana VH, Bhalja B. New adaptive digital distance relaying scheme for double infeed parallel transmission line during inter-circuit faults. *IET Gener Transm Distrib* 2011;5:667–73.

- [11] Coury DV, Oleskovicz M, Aggarwal RK. ANN routine for fault detection, classification and location in Transmission lines. *Electric Power Compo Syst* 2002;30:1137–49.
- [12] Dash PK, Samantaray SR, Panda G. Fault classification and section identification of an advanced series-compensated transmission line using support vector machine. *IEEE Trans Power Delivery* 2007;22(1) [January].
- [13] Samantaray SR, Dash PK, Panda G. Distance relaying for transmission line using support vector machine and radial basis function neural network. *Int J Electr Power Energy Syst* 2007;29:551–6.
- [14] Ravikumar B, Thukaram D, Khincha HP. Application of support vector machines for fault diagnosis in power transmission system. *IET Gener Transm Distrib* 2008;2:119–30.
- [15] Parikh UB, Das B, Maheshwari RP. Combined wavelet-SVM technique for fault zone detection in a series compensated transmission line. *IEEE Trans Power Delivery* 2008;23:1789–94.
- [16] Bhalja B, Maheshwari RP. Wavelet-based fault classification scheme for a transmission line using a support vector machine. *Electric Power Compo Syst* 2008;36:1017–30.
- [17] Parikh UB, Das B, Maheshwari RP. Fault classification technique for series compensated transmission line using support vector machine. *Int J Electr Power Energy Syst* 2010;32:629–36 [July].
- [18] Ekici S. Support vector machines for classification and locating faults on transmission lines. *Appl Soft Comput* 2012;12:1650–8 [June].
- [19] Seethalekshmi K, Singh SN, Srivastava SC. A classification approach using support vector machines to prevent distance relay maloperation under power swing and voltage instability. *IEEE Trans Power Delivery* 2012;27(3):1124–33 [July].
- [20] Jafarian P, Sanaye-Pasand M. High-frequency transients-based protection of multi-terminal transmission lines using the SVM technique. *IEEE Trans Power Delivery* 2013;28(1):188–96 [January].
- [21] Dalei J, Mohanty KB. Fault classification in SEIG system using Hilbert-Huang transform and least square support vector machine. *Int J Electr Power Energy Syst* March 2016;76:11–22.
- [22] Deng X, Yuan R, Xiao Z, Li T, Wang KLL. Fault location in loop distribution network using SVM technology. *Int J Electr Power Energy Syst* February 2015;65:254–61.
- [23] Ye L, You D, Yin X, Wang K, Wu J. An improved fault-location method for distribution system using wavelets and support vector regression. *Int J Electr Power Energy Syst* February 2014;55:467–72.
- [24] B. Rathore, A.G. Shaik, Wavelet-alienation based transmission line protection scheme, *IET Gener. Transm. Distrib.* 11 (4) (2017) 995–1003.
- [25] A.G. Shaik, R.R.V. Pulipaka, A new wavelet based fault detection, classification and location in transmission lines, *Int. J. Electr. Power Energy Syst.* 64 (2015) 35–40.
- [26] A. Yadav, A. Swetapadma, A single ended directional fault section identifier and fault locator for double circuit transmission lines using combined wavelet and ANN approach, *Int. J. Electr. Power Energy Syst.* 69 (2015) 27–33.
- [27] M. Mirzaei, B. Vahidi, S.H. Hosseinian, Fault location on a series-compensated three-terminal transmission line using deep neural networks, *IET Sci. Meas. Technol.* 12 (6) (2018) 746–754.
- [28] A. Said, S. Hashima, M. M. Fouda, and M. H. Saad, “Deep learningbased fault classification and location for underground power cable of nuclear facilities,” *IEEE Access*, vol. 10, pp. 70126–70142, 2022, doi: [10.1109/ACCESS.2022.3187026](https://doi.org/10.1109/ACCESS.2022.3187026).
- [29] M. H. Saad and A. Said, “Machine learning-based fault diagnosis for research nuclear reactor medium voltage power cables in fraction Fourier domain,” *Electr. Eng.*, pp. 1–18, Sep. 2022, doi: [10.1007/s00202-022-01649-7](https://doi.org/10.1007/s00202-022-01649-7).
- [30] D. Akmaz, M. S. Mamis, M. Arkan, and M. E. Tagluk, “Transmission line fault location using traveling wave frequencies and extreme learning machine,” *Electric Power Syst. Res.*, vol. 155, pp. 1–7, Feb. 2018, doi: [10.1016/j.epsr.2017.09.019](https://doi.org/10.1016/j.epsr.2017.09.019).
- [31] M. Al-Gabalawy, A. H. Elmetwaly, R. A. Younis, and A. I. Omar, “Temperature prediction for electric vehicles of permanent magnet synchronous motor using robust machine learning tools,” *J. Ambient Intell. Humanized Comput.*, pp. 1–18, May 2022, doi: [10.1007/s12652-022-03888-9](https://doi.org/10.1007/s12652-022-03888-9).
- [32] H. V. G. Rao, N. Prabhu, and R. C. Mala, “Wavelet transform-based protection of transmission line incorporating SSSC with energy storage device,” *Electr. Eng.*, vol. 102, no. 3, pp. 1593–1604, Sep. 2020, doi: [10.1007/s00202-020-00978-9](https://doi.org/10.1007/s00202-020-00978-9).
- [33] A. Yadav and A. Swetapadma, “Enhancing the performance of transmission line directional relaying, fault classification and fault location schemes using fuzzy inference system,” *IET Gener., Transmiss. Distrib.*, vol. 9, no. 6, pp. 580–591, Apr. 2015, doi: [10.1049/iet-gtd.2014.0498](https://doi.org/10.1049/iet-gtd.2014.0498).
- [34] M. J. Reddy and D. K. Mohanta, “A wavelet-fuzzy combined approach for classification and location of transmission line faults,” *Int. J. Electr. Power Energy Syst.*, vol. 29, no. 9, pp. 669–678, Nov. 2007, doi: [10.1016/j.ijepes.2007.05.001](https://doi.org/10.1016/j.ijepes.2007.05.001).
- [35] T.F. Moraes, L. Lovisololo, L.F.C. Monteiro, Fault location in distribution systems from analysis of the energy of sequence component waveforms, *IET Gener. Transm. Distrib.* 12 (9) (2018) 1951–1960.
- [36] S. Biswal, M. Biswal, O.P. Malik, Hilbert Huang transform based online differential relay algorithm for a shunt-compensated transmission line, *IEEE Trans. Power Deliv.* 33 (6) (2018) 2803–2811.
- [37] B. Chatterjee, S. Debnath, Fuzzy based relaying scheme for transmission line based on unsynchronized voltage measurement, *IETE J. Res.* (2020) 10.1080/03772063.2020.1754934.
- [38] P. Jena, A.K. Pradhan, An integrated approach for directional relaying of the double-circuit line, *IEEE Trans. Power Deliv.* 26 (3) (2011) 1783–1792.
- [39] B. Chatterjee, S. Debnath, Cross-correlation aided fuzzy based relaying scheme for fault classification in transmission lines, *Eng. Sci. Technol. Int. J.* 23 (2020) 534–543.